

NOTE: DIMENSIONS IN [] ARE ENGLISH EQUIVALENTS.

| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED: 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: X-XX X-X X ANGLES SURFACE FINISH MAX. |
|-----|---------|---|--------------|---|
| - | 4-16-13 | NEW DRAWING [CT73590] | GFR | |
| A | 6-6-14 | (B-5) 824 ADDED, 810 REMOVED (B-4) 345 ADDED [CT82275] | KRM | |
| B | 7-25-14 | SEE SHEET 3 OF 3. [CT88146] | GFR | |
| | | | | THIRD ANGLE PROJECTION |
| | | | | APPROVALS DATE |
| | | | DRAWN GFR | 4-16-13 |
| | | | CHECKED GFR | 4-16-13 |
| | | | APPROVED KEM | 4-16-13 |

KOHLER CO.
POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.

METRIC PRO-E


DIMENSION PRINT

SCALE 0.15 CAD NO. SHEET 1 of 3
DWG NO. ADV-8539 D


RESV

8

2

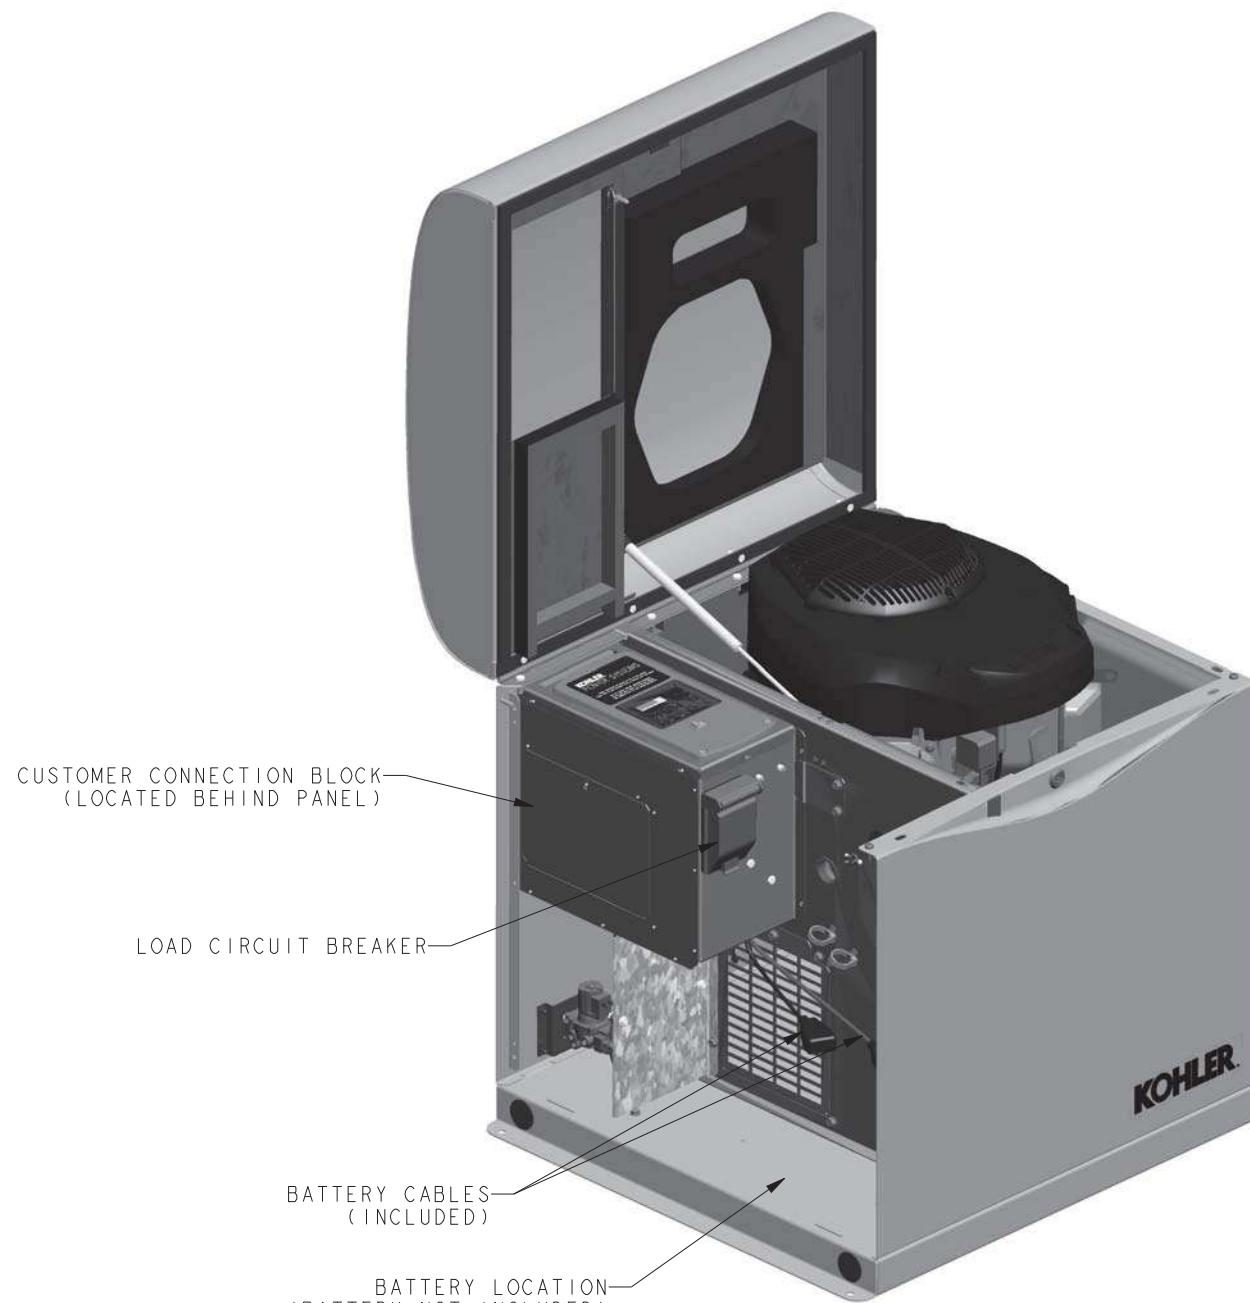




VIEW FROM EXHAUST AIR OUTLET

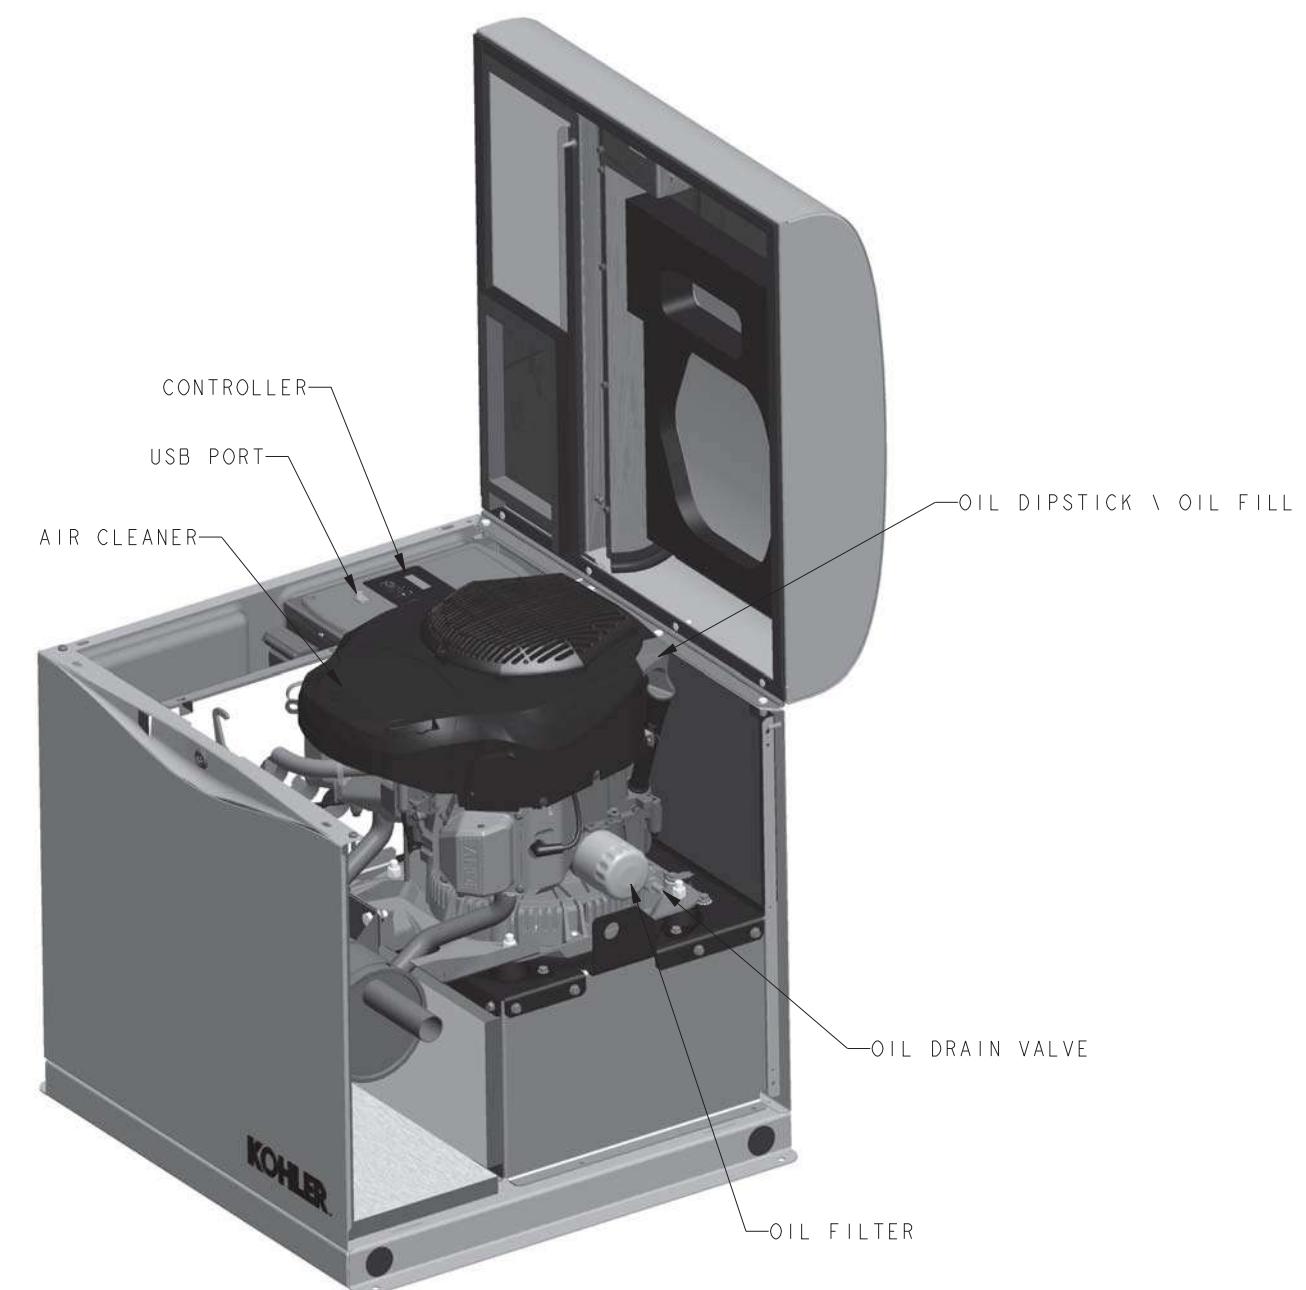

**VIEW FROM
EXHAUST AIR OUTLET**

RESV

| | | | | | | |
|-----|---------|--|-----------|--|--|--|
| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: | KOHLER CO. POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK, ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. | |
| - | 4-16-13 | NEW DRAWING [CT73590] | GFR | X, XX X, X X | | |
| A | 6-6-14 | SEE SHEET 1 OF 1 [CT82275] | KRM | SURFACE FINISH ANGLES  MAX. | | |
| B | 7-25-14 | SEE SHEET 3 OF 3. [CT88146] | GFR | | | |
| | | | APPROVALS | DATE | TITLE DIMENSION PRINT SCALE 0.20 CAD NO. SHEET 2 of 3 DNG NO. ADV-8539 D | |
| | | | DRAWN | GFR 4-16-13 | | |
| | | | CHECKED | GFR 4-16-13 | | |
| | | | APPROVED | KEM 4-16-13 | | |

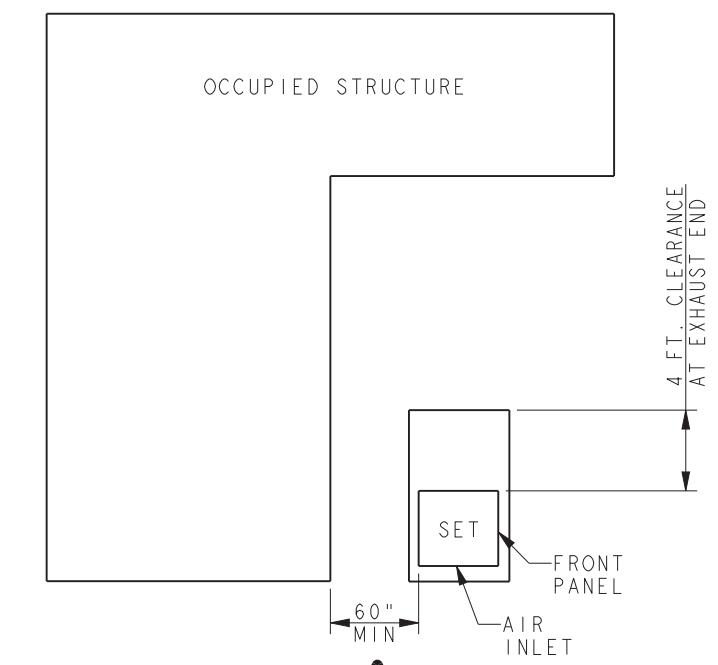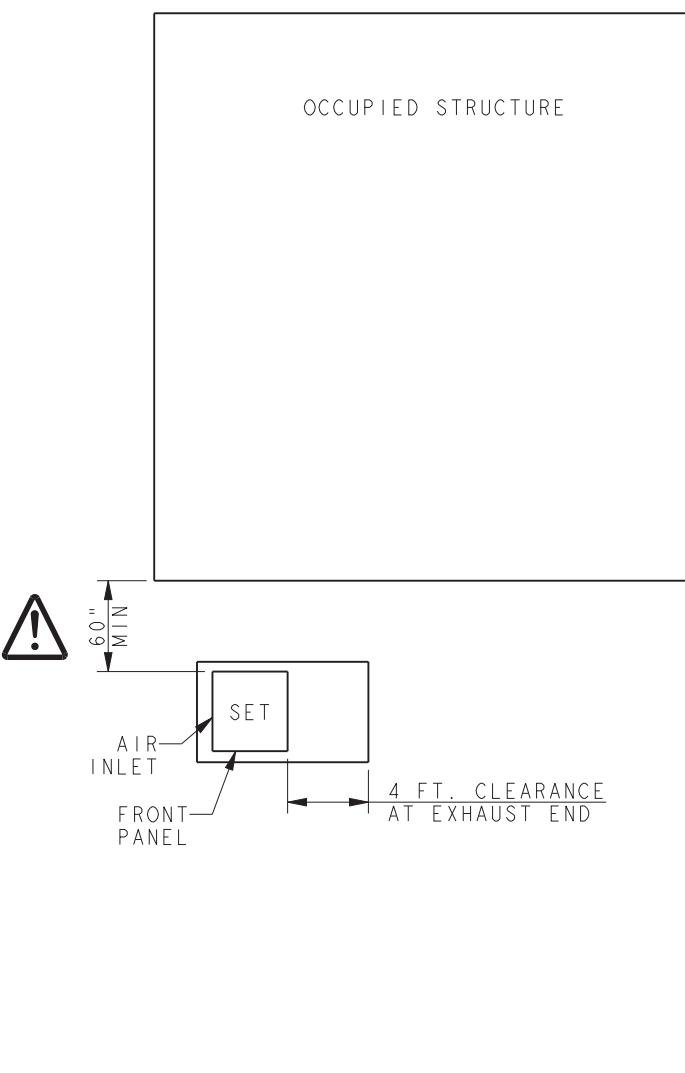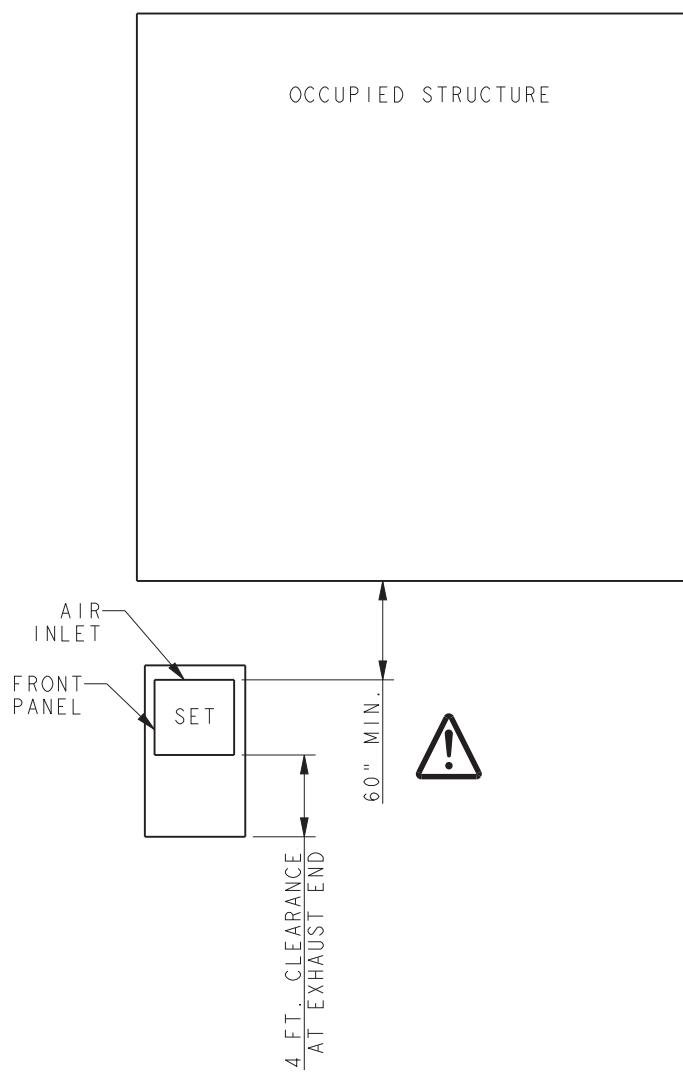

ACCEPTABLE

- 1) EXHAUST IS AIMED AWAY OR PARALLEL TO STRUCTURE.
- 2) EXHAUST IS NOT DIRECTED AT PLAY AREAS, PATIOS OR OTHER AREAS WHERE PEOPLE CONGREGATE.
- 3) THE NEAREST WINDOW, VENT, DOOR OR SIMILAR STRUCTURE OPENING IS AT LEAST 5 FEET FROM THE EXHAUST END OF THE SET.
- 4) SET HAS PROPER OFFSET FROM STRUCTURE.
- 5) WINDOWS & DOORS ON ADJACENT WALLS ARE CLOSED.
- 6) FURNACE AND OTHER SIMILAR INTAKES ARE AT LEAST 10 FEET FROM EXHAUST END OF SET.
- 7) WEED BARRIER AND 3 INCH THICK GRAVEL BASE LOCATED TO PREVENT GRASS & WEEDS FROM GROWING TOO CLOSE TO THE SET.
- 8) NO PLANTS, SHRUBS OR OTHER COMBUSTIBLES ALLOWED IN GRAVEL AREA. (MINIMUM 4 FT. FROM EXHAUST END).
- 9) REFER TO OWNERS MANUAL FOR OTHER INSTALLATION CONSTRAINTS.
- 10) NO PLANTS, SHRUBS, OR OTHER COMBUSTIBLES ALLOWED WITHIN 18" OF AIR INTAKE.

NOTE:

THE REQUIRED DISTANCE FROM A STRUCTURE IS DEPENDENT ON STATE AND LOCAL CODES. NFPA 37, STANDARDS FOR THE INSTALLATION AND USE OF STATIONARY COMBUSTION ENGINES AND GAS TURBINES.

| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED : |
|-----|---------|--|----------|--|
| - | 4-16-13 | NEW DRAWING [CT73590] | GFR | 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: |
| A | 6-6-14 | SEE SHEET 1 OF 1 [CT82275] | KRM | X. XX X. X |
| B | 7-25-14 | (C-7), (C-4) AND (C-2) 60" MIN WAS 18"MIN. [CT88146] | GFR | SURFACE FINISH ANGLES MAX. |
| | | | | THIRD ANGLE PROJECTION |
| | | | | APPROVALS DATE |
| | | | DRAWN | GFR 4-16-13 |
| | | | CHECKED | GFR 4-16-13 |
| | | | APPROVED | KEM 4-16-13 |

KOHLER CO. METRIC PRO-E
POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.

DIMENSION PRINT

SCALE 0.15 CAD NO. SHEET 3 of 3
DWG NO. ADV-8539 D